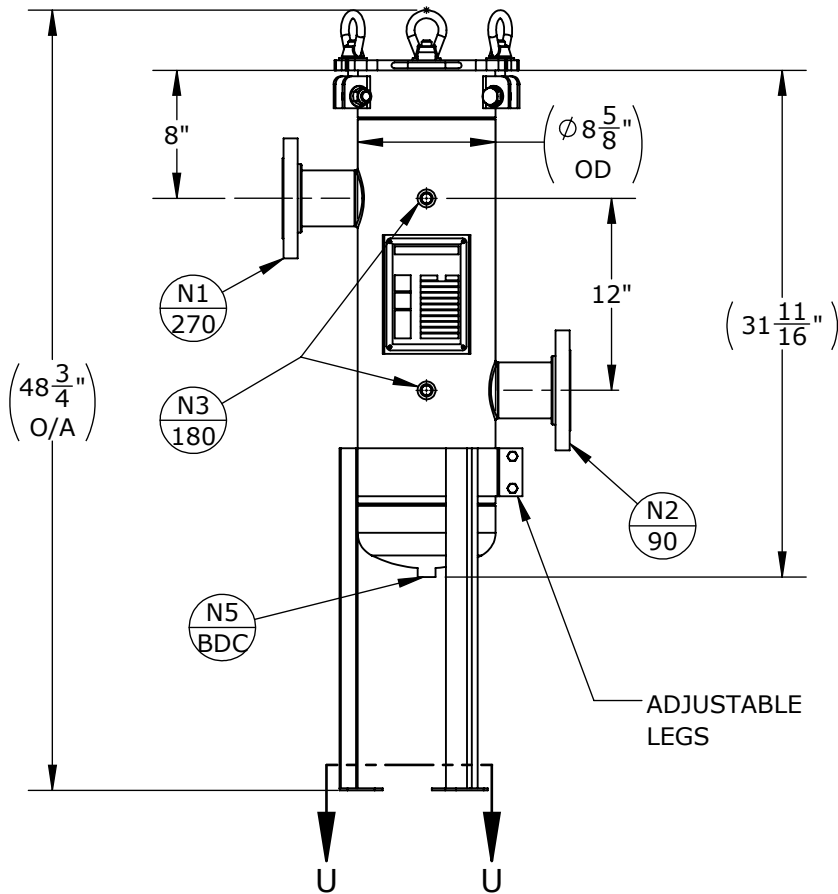
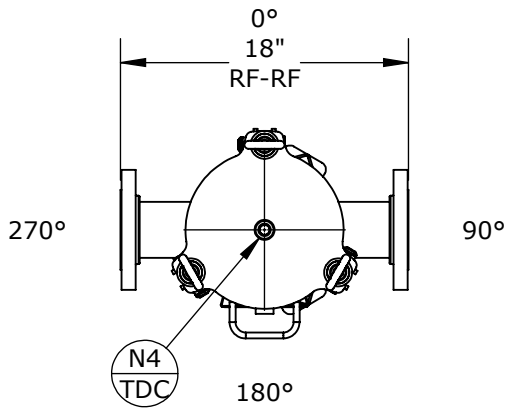



SECTION U-U
SCALE 1 : 12

NOZZLE SCHEDULE

MARK	QTY	SIZE / RATING	DESCRIPTION
N1	1	3" RFSO CL150	INLET
N2	1	3" RFSO CL150	OUTLET
N3	2	1/2" NPT CL3000	PRESSURE GAUGE
N4	1	1/2" NPT CL3000	VENT
N5	1	1/2" NPT CL3000	CLEAN DRAIN
N6	0		DIRTY DRAIN

VESSEL DESIGN CONDITIONS

CODE:	ASME SECTION VIII DIV. 1, 2019 EDITION		
M.A.W.P.:	150 PSI @ 400°F	M.D.M.T.:	-20°F @ 150 PSI
M.A.W.P.:	FV PSI @ 400°F	HYDROTEST PRESS:	195 PSI
CORROSION ALLOWANCE:	N/A	SERVICE:	UNK. LIQUID, NON-LETHAL
STAMP:	UM	RADIOGRAPHY:	N/A
PWHT:	N/A	GASKET:	☐ BUNA ☐ VITON ☐ EPDM
MATERIAL:	SS316	☐ OTHER:	
NOTES:		FACTORY INSTALLED OPTIONS:	
DRY WEIGHT: 130 LBS		☐ STAINLESS STEEL BOLTING (SS316)	
SHIPPING WEIGHT: 160 LBS		☐ MESH LINED BASKETS: _____ MESH	
VOLUME: 0.75 CU. FT.		☐ N3 DIFFERENTIAL PRESSURE GAUGE	
INTERNALS: 1 X SIZE 1 BAKSET		TYPE: _____	
		☐ N4 PRESSURE RELIEF VALVE	
		TYPE: _____	
		☐ N4 AIR ELIMINATOR	
		TYPE: _____	
		☐ N4 VENT VALVE	
		☐ N5/N6 DRAIN VALVES	

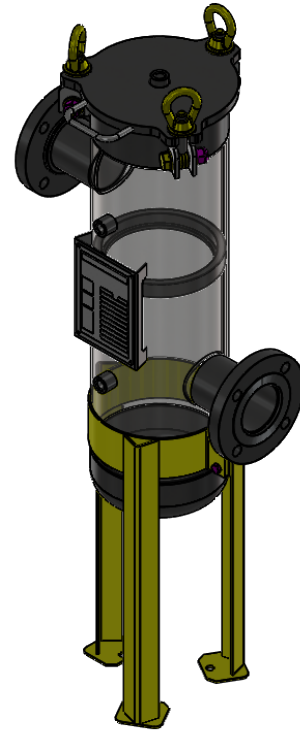

APPROVED WITH MARK-UPS ☐ APPROVED ☐



THIRD ANGLE
PROJECTION
TOLERANCES-UNLESS
OTHERWISE NOTED
DECIMAL .X = ±.1"
.XX = ±.02"
.XXX = ±.005"
FRACTIONAL .X = ±1/8"
ANGULAR = ± 1°
MAX. MACHINED
SURFACE FINISH 125/



FIL-TREK CORPORATION

55 Stafford Court
Cambridge, Ontario
N1T 1B3
Canada

Phone: (519) 623-7448
Fax: (519) 623-8807
Email: info@fil-trek.com
Website: www.fil-trek.com

THIS DRAWING IS THE PROPERTY OF 'FIL-TREK CORPORATION' AND MUST NOT BE COPIED OR USED
IN ANY WAY DETRIMENTAL TO THE CORPORATION

EQUIPMENT: SL SERIES (BAG FILTER HOUSING)

MODEL NO: S6SL111-3F-A-150

CUSTOMER:

VESSEL
QUANTITY:

DRAWN: CL
CHK'D: AJ

DATE:
2020-03-05
SCALE: NTS

SERIAL No.

Part No.
002002-00627

REV. No.
0